



CARPENTER'S INSTRUCTIONS


Tank Room

1. Must be in a separate room or cabinet.
2. A drywall studded room with a one hour fire rating will suffice.
3. Door should lock.
4. Room should be vented (72 square inch minimum). A vent in the door will suffice, only if no other area is available.
5. Attach tank restrainers with lag screws. Install 40" from the floor.
6. Tank Room Instructions (LB-315) and Caution for Non-flammable Medical Gases in Use (LB-612) are posted.

Minimum size for tank room

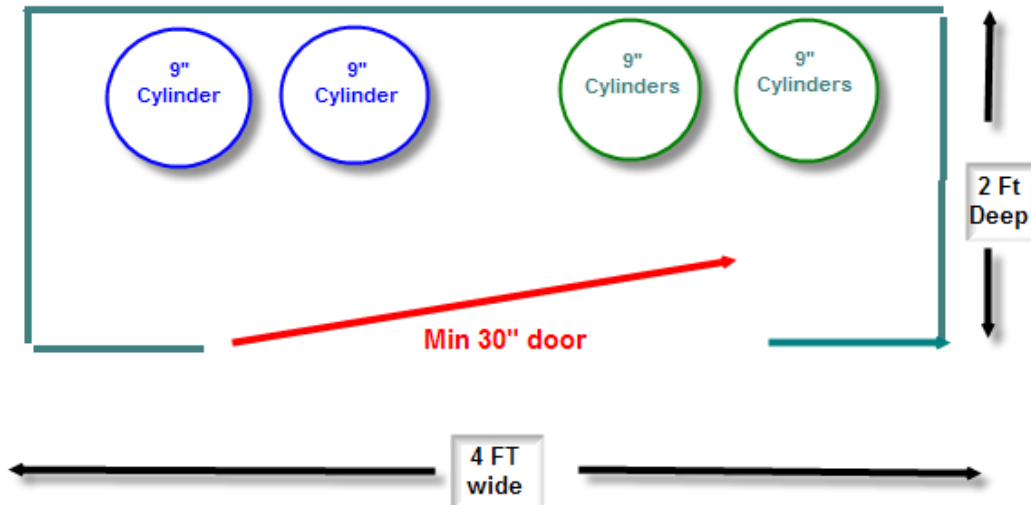

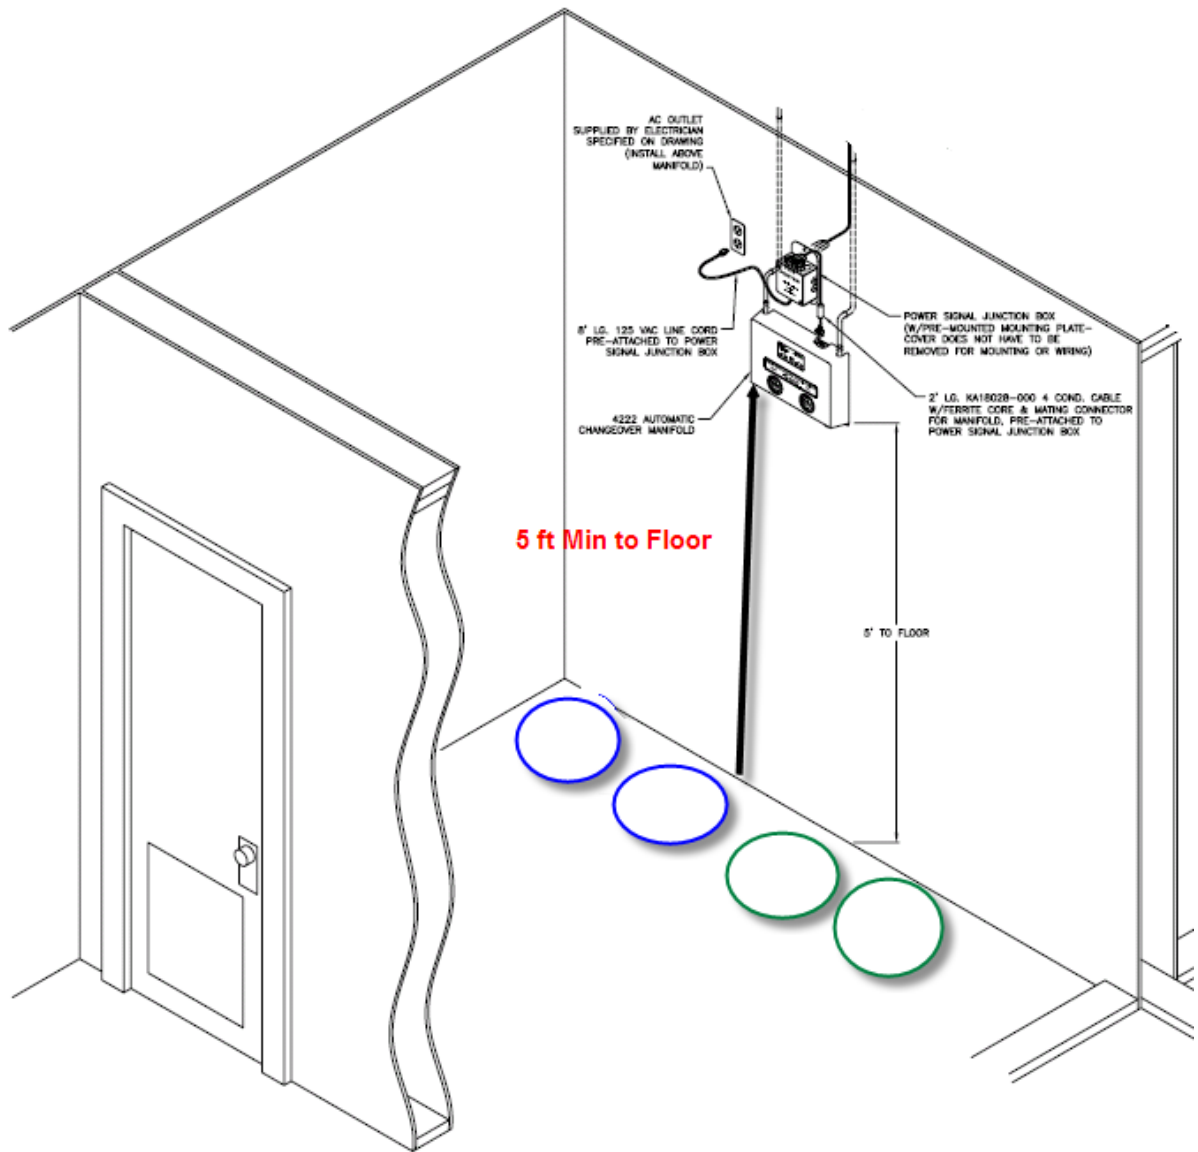

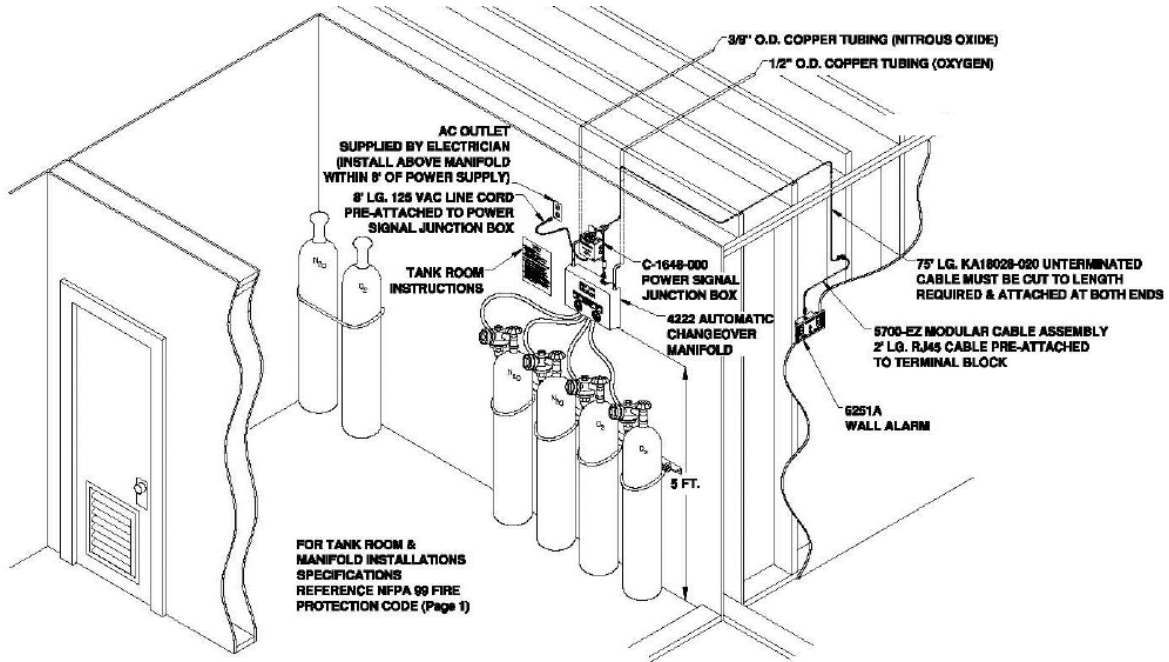

TYPICAL TANK ROOM LAYOUT